
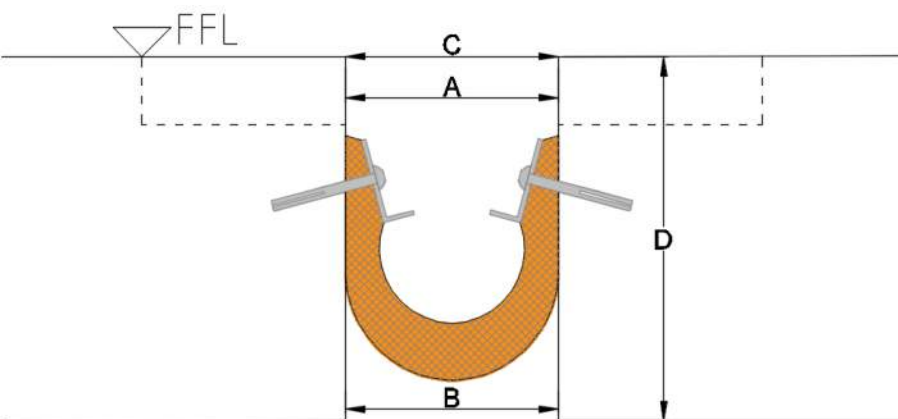


Pyrotx B Fire Blankets for EJs

Pyrotx B: Designed to accommodate seismic activity, PyB is a very high movement fire-blanket system. The PyB is tested/certified to Australian and British standards for gaps of 250mm.... with movement well in excess of this. PyB can be used in walls and floors, and can be applied in conjunction with a range of Unison coverplate systems.

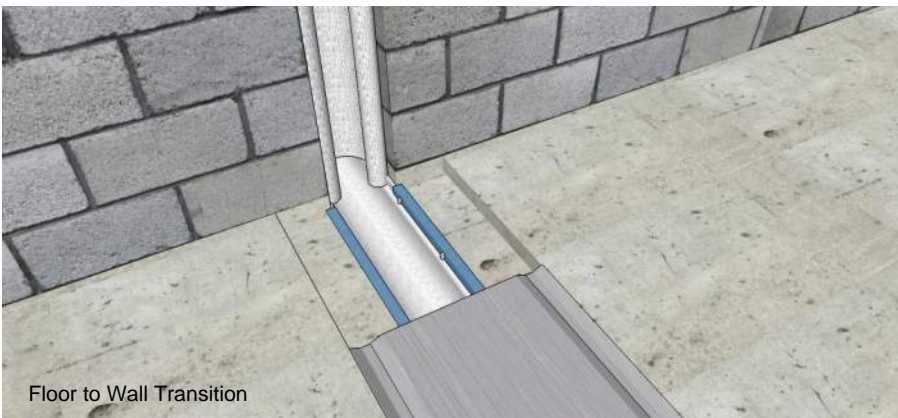

Product	A: Seal		B: Gap				C: Installation Width
	Width	Thick	Min.	Mid.	Max.	Mvmt.	
Py25/300B	300	25	50	113	175	125	70
Py25/400B	400	25	50	163	275	225	70
Py25/600B	600	25	50	263	475	425	70

Block Out: Minimum Element Thickness D 120mm

Disclaimer: All design rights reserved. Design and specifications are subject to change without notice. The manufacturer does not accept liability where the material on these pages is misconceived, exploited, or lacks conformity. The intention of this information is to provide a reasonable description of products, procedures and capabilities. Rev.4



Py B

Previous Model No: UFB



Performance

- Expansion Joint Fireseal
- High fire resistance
- High movement capacity
- Certified to 250mm gaps
- Floor application
- Wall system seals both sides
- Compatible with coverplates & water seals

Tested and comply with:
AS 1530.4
AS 4072.1
BS 476.20

Standard Length

7.2m

EWFA CERTIFICATE OF ASSESSMENT | CERTIFICATE No: SFC 27465-01 | Page 1 of 1

Report Sponsor: Unison Joints Pty Ltd, 130A Englewood Road, Wembley QLD 4104
Certificate Issue Date: 19/07/2016
Product Name: 25mm FIREMASTER Blanket Control Joint

Assessment Reference: EWFA 27465-01 | **Referenced Standard:** AS 1530.4-2005 | **Report Issue Date:** 09/07/2016 | **Report Validity Date:** 31/03/2017

Introduction: The element of construction described below was assessed by this Laboratory on behalf of the report sponsor in accordance with the stated test standard and achieved the results stated below. Refer to the referenced test reports or Regulatory Information Reports for a complete description of the assessed construction.

Control Joint	Orientation of Joint	Support Element	Opening Width	Direction of Exposure	FFL
A FIREMASTER Blanket 25mm thick	Horizontally or vertically	Concrete or Masonry Wall	70mm to 100mm wide 100mm to 250mm wide	Fire from either side	$-240/120$

Refer the referenced report for a complete description of the assessed construction.

CONFORMANCE STATEMENT: THIS CERTIFICATE IS PROVIDED FOR GENERAL INFORMATION ONLY AND DOES NOT COMPLY WITH THE REGULATORY REQUIREMENTS FOR EVIDENCE OF COMPLIANCE. Reference should be made to the relevant test report or regulatory information report to determine the applicability of the test result to a proposed installation. Full details of the construction and justification for the conditions given, along with the validity statements, are given in the assessment reports. The assessment report or sheet form assessment report does not provide an endorsement by Exova Warringtonshire Australia of the performance of the actual products supplied. It is intended to provide a clear outline of the above referenced assessment reports and not to replace them. The conditions in this certificate of assessment are detailed, and should not be applied to any other configuration. The conditions expressed in this document assess fire hazard, but it should be recognised that a single test method will not provide a full assessment of the hazard under all conditions. Full copies of the assessment and relevant test reports may be obtained from the sponsor.

TESTING AUTHORITY: Exova Warringtonshire Australia Pty Ltd
 141 St. George's Road, St. George's, Sydney NSW 2000, Australia
 Phone: +61 2 9291 7000 | Fax: +61 2 9291 8076
 Email: info@exova.com.au | Website: www.exova.com.au

Assessed By: [Signature] | **Reviewed By:** [Signature]
 S. Yu | D. Nicholson

This document remains Unison Joints Pty. Ltd.'s property. COMMERCIAL IN CONFIDENCE

