
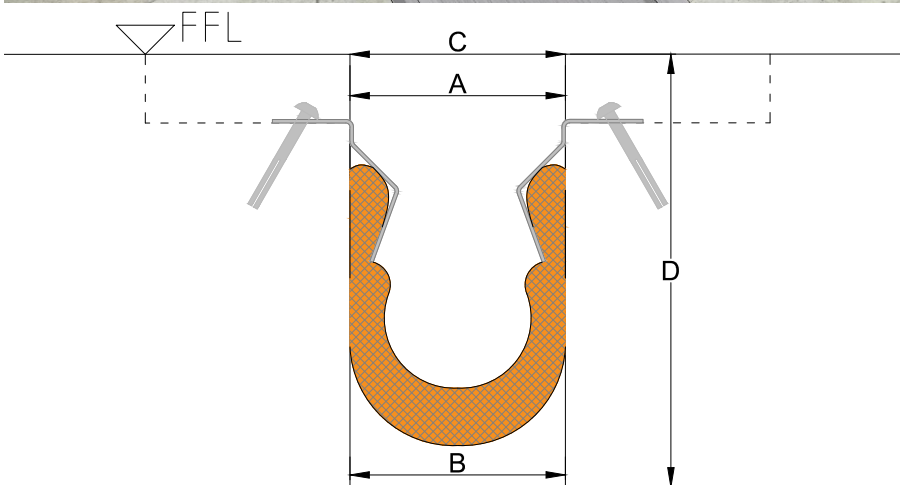
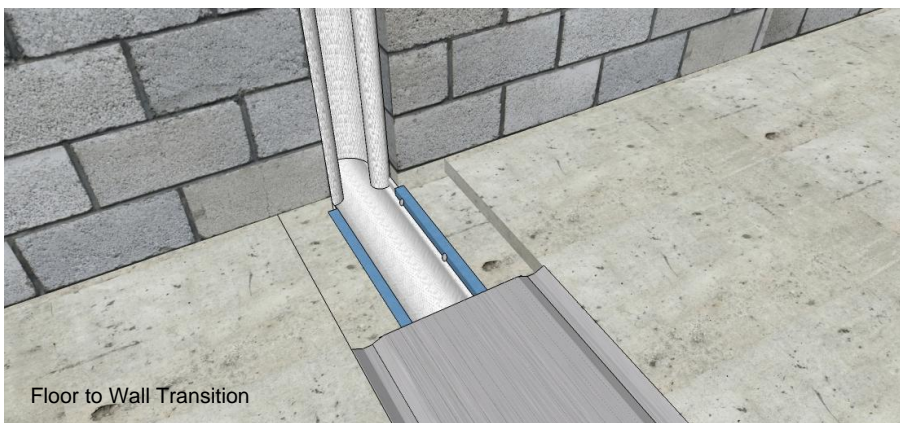


Pyrotx B Fire Blankets for EJs

Pyrotx B: Designed to accommodate seismic activity, PyB is a very high movement fire-blanket system. The PyB is tested/certified to Australian and British standards for gaps of 330mm.... with movement well in excess of this. PyB can be used in masonry walls and floors, and can be applied in conjunction with a range of Unison coverplate systems.

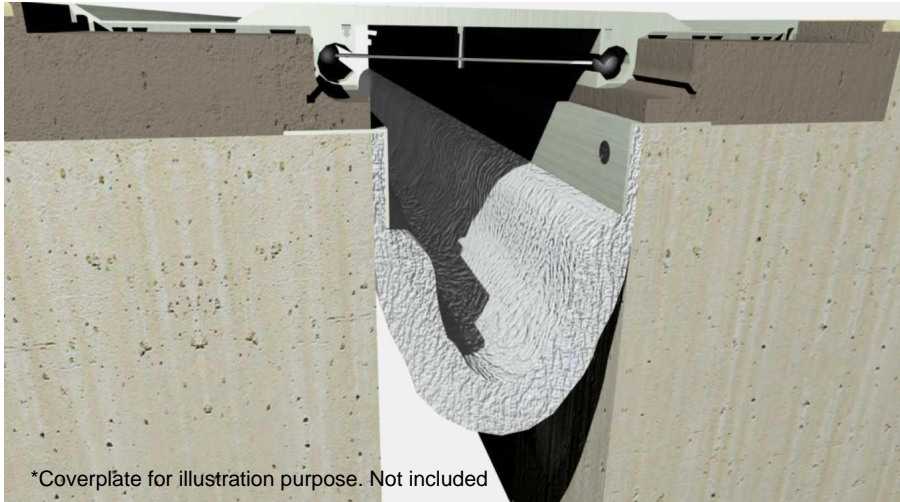

THE ART OF COVERPLATES

Py B

Previous Model No: UFB

Indoor Outdoor Multi-directional

Performance

- Expansion Joint Fireseal
- High fire resistance
- High movement capacity
- Certified to 330mm gaps
- Floor application
- Wall system seals both sides
- Compatible with coverplates & water seals
- Tested and comply with:
 - AS 1530.4
 - AS 4072.1
 - BS 476.20

Standard Length
7.2m

This document remains Unison Joints Pty. Ltd.'s property. COMMERCIAL IN CONFIDENCE

EXOVA

Testing, Advicing, Assessing

EWFA CERTIFICATE OF ASSESSMENT

Report Sponsor	Certificate Issue Date	Product Name
Unison Joints Pty Ltd 130A Engleston Road Willetton QLD 4104	19/07/2016	25mm FIREMASTER Blanket Control Joint
Assessment Reference	Reference Standard	Report Issue Date
EWFA 27465-01	AS 1530.4-2005	30/07/2017

Introduction

The element of construction described below was assessed by the Laboratory on behalf of the report sponsor in accordance with the stated test standard and achieved the results stated below. Refer to the referenced test reports or Regulatory Information Reports for a complete description of the assessed construction.

Control Joint	Orientation of Joint	Support Element	Opening Width	Direction of Exposure	FFL
A FIREMASTER Blanket 25mm thick	Horizontally or vertically	Concrete or Masonry Wall	70mm to 100mm wide 100mm to 250mm wide	Fire from either side	>40/120

Refer the referenced report for a complete description of the assessed construction.

CONFORMANCE

THIS CERTIFICATE IS PROVIDED FOR GENERAL INFORMATION ONLY AND DOES NOT COMPLY WITH THE REGULATORY REQUIREMENTS FOR EVIDENCE OF COMPLIANCE.

- Reference should be made to the relevant test report or regulatory information report to determine the applicability of the test result to a proposed installation. Full details of the construction and justification for the conditions given, along with the validity statements, are given in the assessment reports.
- The assessment report or about form assessment report does not provide an endorsement by Exova Warrington Australia Pty Ltd of the performance of the actual products supplied. It is intended to provide a brief outline of the above referenced assessment reports and not to replace them.
- The conditions in this certificate of assessment apply to the configurations as detailed, and should not be applied to any other configuration. The conditions expressed in this document assess fire hazard, but it should be recognised that a single test method will not provide a full assessment of the hazard under all conditions.
- Full copies of the assessment and relevant test reports may be obtained from the sponsor.

TESTING AUTHORITY	Exova Warrington Australia Pty Ltd
Address	Exova Warrington Australia Pty Ltd, 130A Engleston Road, Willetton, Western Australia 6104
Phone / Fax	+61 (0)8 9270 7000 / +61 (0)8 9270 8076
URL	www.exova.com.au
Email / Mobile Page	sales@exova.com.au / +61 (0)8 9270 7000
Authorisation	Approved By: [Signature] / Reviewed By: [Signature]

Product	A: Seal		B: Gap				C: Min Install Width	D: Slab Thickness
	Width	Thick	Min.	Mid.	Max.	Mvmt.		
Py25/300B	300	25	50	113	175	125	70	120
Py25/300B Soffit	300	25	0	75	150	150	>0	120
Py25/400B	400	25	50	163	275	225	70	120
Py25/600B	600	25	50	263	475	425	70	120
Py25/600B Triple	600	63	75	275	475	400	100	150

Block Out: Minimum Element Thickness D 120mm

Disclaimer: All design rights reserved. Design and specifications are subject to change without notice. The manufacturer does not accept liability where the material on these pages is misconceived, exploited, or lacks conformity. The intention of this information is to provide a reasonable description of products, procedures and capabilities. Rev.8